

Schedule A - Pole Attachment Application

Pole Attachment Application for the Village of Yellow Springs, Ohio

The applicant's rights, obligations, and remedies relating to this application are set forth in, and governed solely by, the Pole Attachment Agreement by and between the Village of Yellow Springs, Ohio ("Municipality") and the applicant hereunder ("Licensee").

Licensee will submit application form electronically to Zoning Office **ATTN: permits@yellowsprings.gov**. Municipality is responsible to inform Licensee if any changes to electronic submission contacts are changed. Incomplete applications will be returned to the Licensee without further action by the Municipality. Required information includes the completed application, proposed schedule, prints and maps, proposed route and project description. See Schedule D for example of Sample Drawing and Attachment Details.

Application Information

Application# _____ Date _____

Applicant Name _____

Applicant Representative _____

Phone _____ Fax _____ E-mail _____

Project Description (Attach if necessary)	No.of Municipality poles	No.of foreign poles	Planned Install Date

Proposed Cable Installation. _____

Existing Cable Installation _____

No. of cables to install _____

Existing cable count _____

Fiber count _____

Existing pole count _____

Pole count _____

Cable(s) diameter _____

Cable diameter _____

Strand(s) diameter _____

Applicant

By: _____

Name: _____

Municipality Review

Application Approved? Yes___ No___ Conditional (See attached report) ___

Make Ready Work Required? Yes___ No___

Actual Municipality pole count _____

Actual foreign pole count _____

Actual Install Date _____

Comments/Notes (attach if necessary)

Municipality Inspector (sign)

Phone

Fax


Email

Date

--	--	--	--	--

Schedule B - Pole Attachment Specifications

Municipality states it does not have standards for attachment of Fiber or Cable. Licensee is to follow best practices.

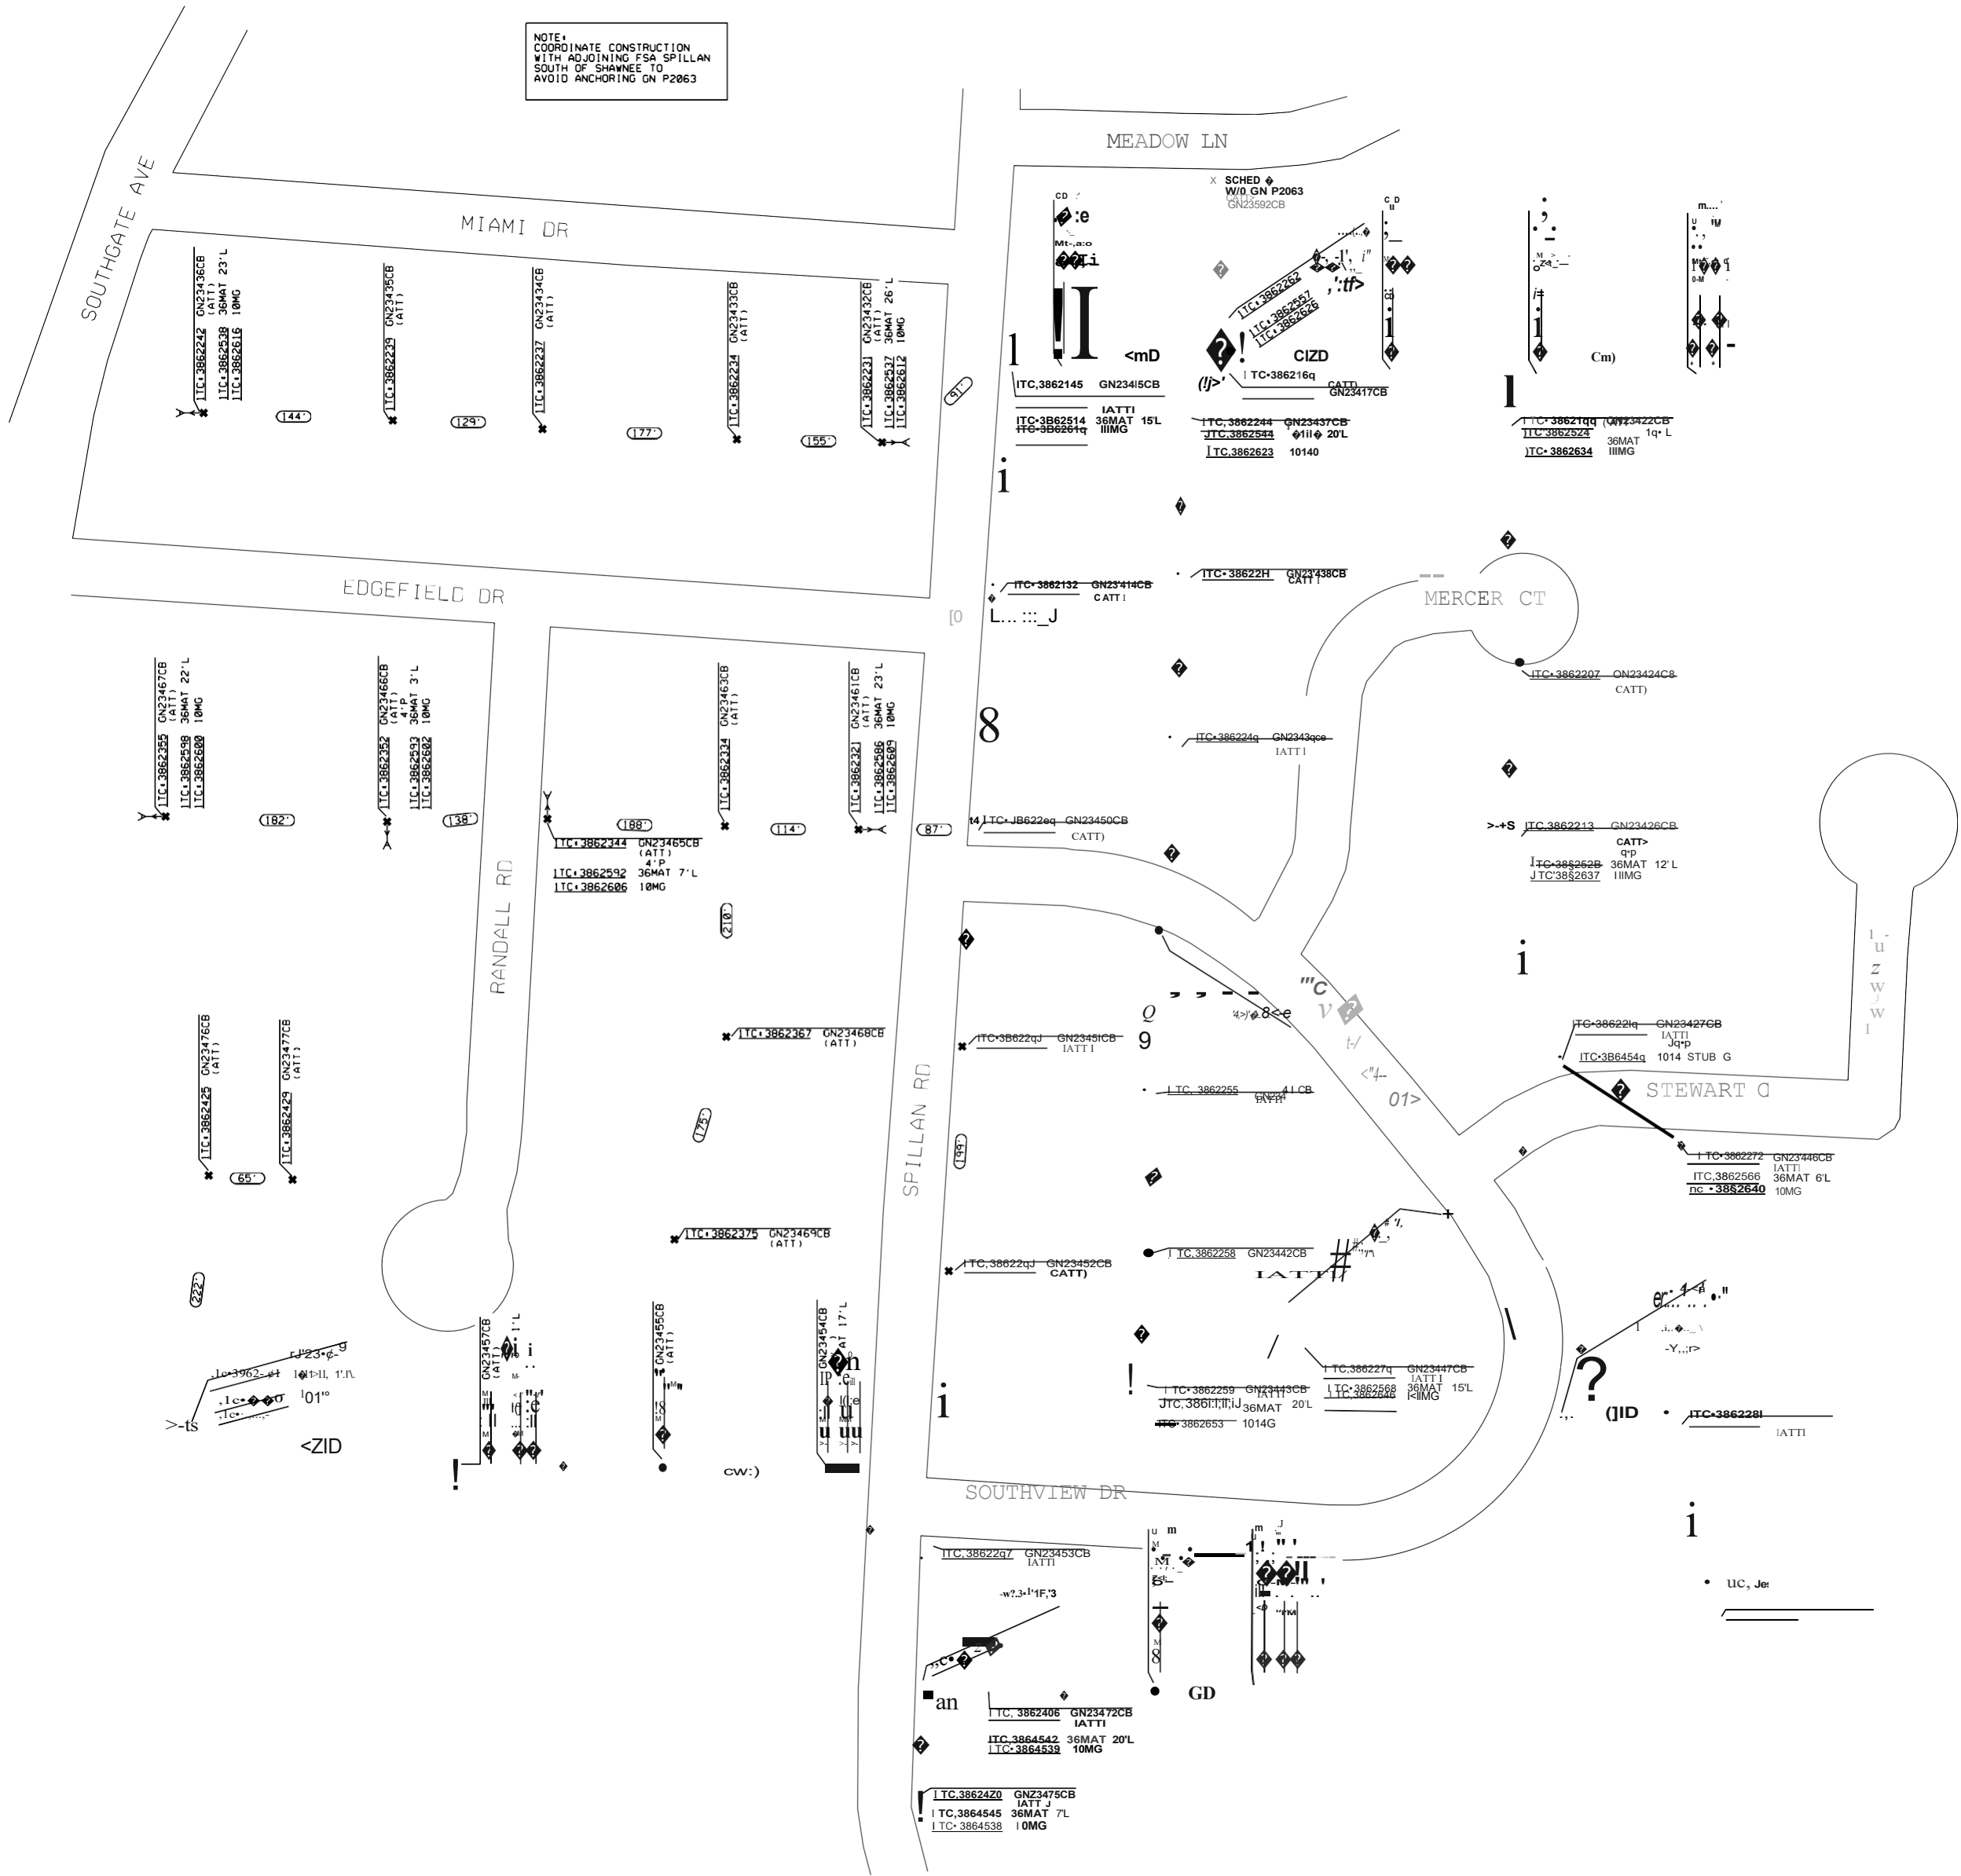

505552 2
N
4

Poles										
CBX Pole Number	ATT Pole Number	Address	Street Name	Dist and Dir from Ref Loc	Reference Location	New Attachment Type	New Attachment Height	New Cable Wt. (lbs/100')	Comments	JUR#
GN23414CB	NPT1		SPILLAN RD	206'S	GN23415CB	Cable	22'2"	11.9, 15.2	FIBER CT-144 DIAMETER-.63" FIBER CT- 288 DIAMETER-.72" STRAND - 6.6M GALVANIZED STRING TENSION - 6,600 LBS DIAMETER-.25" WT - 12.1 LBS/100'	CBX2404ATT0219
GN23442CB	NPT23	1665	SPILLAN RD R/W		REAR	Cable	22'6"	5.4	FIBER CT- 48 DIAMETER-.4" STRAND - 6.6M GALVANIZED STRING TENSION - 6,600 LBS DIAMETER-.25" WT - 12.1 LBS/100'	CBX2404ATT0219
GN23443CB	NPT24	1669	SPILLAN RD R/W		REAR	Cable	15'2"	5.4	FIBER CT- 48 DIAMETER-.4" STRAND - 6.6M GALVANIZED STRING TENSION - 6,600 LBS DIAMETER-.25" WT - 12.1 LBS/100'	CBX2404ATT0219
GN23444CB	NPT25		MEADOW LN R/W	61'N	GN23417CB	Cable	21'8"	0	'STRAND ONLY' STRAND - 6.6M GALVANIZED STRING TENSION - 6,600 LBS DIAMETER-.25" WT - 12.1 LBS/100'	CBX2404ATT0219
GN23445CB	NPT26	1620	MERCER CT R/W		REAR	Service	20'8"	5.4	FIBER DROP DIAMETER-.4" STRAND - 6.6M GALVANIZED STRING TENSION - 6,600 LBS DIAMETER-.25" WT - 12.1 LBS/100'	CBX2404ATT0219
GN23446CB	NPT27		STEWART DR	134'SE	GN23427CB	Cable	21'8"	0	"STUB POLE ONLY" STRAND - 6.6M GALVANIZED STRING TENSION - 6,600 LBS DIAMETER-.25" WT - 12.1 LBS/100'	CBX2404ATT0219
GN23447CB	NPT28	1730	SOUTHVIEW DR R/W		REAR	Service	16'11"	5.4	FIBER DROP DIAMETER-.4" STRAND - 6.6M GALVANIZED STRING TENSION - 6,600 LBS DIAMETER-.25" WT - 12.1 LBS/100'	CBX2404ATT0219
GN23448CB	NPT29		SOUTHVIEW DR R/W	101'SE	GN23430CB	Service	21'1"	5.4	FIBER DROP DIAMETER-.4"	CBX2404ATT0219
GN23441CB	NPT22	1655	SPILLAN RD R/W		REAR	Cable	20'11"	5.4	FIBER CT- 48 DIAMETER-.4" STRAND - 6.6M GALVANIZED STRING TENSION - 6,600 LBS DIAMETER-.25" WT - 12.1 LBS/100'	CBX2404ATT0219
GN23449CB	NPT30	1755	SOUTHVIEW DR R/W		REAR	Service	24'0"	5.4	FIBER DROP DIAMETER-.4"	CBX2404ATT0219
GN23451CB	NPT32		SPILLAN RD	170'S	GN23450CB	Cable	20'9"	11.9	FIBER CT-144 DIAMETER-.63" STRAND-6.6M GALVANIZED STRING TENSION-6600 LBS DIAMETER-.25" WT-12.1 LBS/100'	CBX2404ATT0219
GN23452CB	NPT33		SPILLAN RD	199'SW	GN23451CB	Cable	22'8"	11.9	FIBER CT-144 DIAMETER-.63" STRAND-6.6M GALVANIZED STRING TENSION-6600 LBS DIAMETER-.25" WT-12.1 LBS/100'	CBX2404ATT0219
GN23453CB	NPT34		SPILLAN RD	272'S	GN23452CB	Cable	19'0"	5.4, 11.9	FIBER CT-24 DIAMETER-.4" FIBER CT-144 DIAMETER-.63" STRAND-6.6M GALVANIZED STRING TENSION-6600 LBS DIAMETER-.25" WT-12.1 LBS/100'	CBX2404ATT0219
GN23454CB	NPT35		SPILLAN RD R/W	95'NW	GN23453CB	Cable	23'6"	11.9	FIBER CT-144 DIAMETER-.63" STRAND-6.6M GALVANIZED STRING TENSION-6600 LBS DIAMETER-.25" WT-12.1 LBS/100'	CBX2404ATT0219
GN23455CB	NPT36	1720	SPILLAN RD R/W		REAR	Cable	20'8"	11.9	FIBER CT-144 DIAMETER-.63" STRAND-6.6M GALVANIZED STRING TENSION-6600 LBS DIAMETER-.25" WT-12.1 LBS/100'	CBX2404ATT0219
GN23457CB	NPT37	1725	RANDALL RD R/W		REAR	Cable	22'11"	11.9	FIBER CT-144 DIAMETER-.63" STRAND-6.6M GALVANIZED STRING TENSION-6600 LBS DIAMETER-.25" WT-12.1 LBS/100'	CBX2404ATT0219
GN23458CB	NPT38	1750	RANDALL RD R/W		REAR	Cable	20'9"	5.4, 11.9	FIBER DROP DIAMETER-.4" FIBER CT-144 DIAMETER-.63" STRAND-6.6M GALVANIZED STRING TENSION-6600 LBS DIAMETER-.25" WT-12.1 LBS/100'	CBX2404ATT0219

GN23450CB	NPT31		SPILLAN RD	196'S	GN23414CB	Cable	21'0"	5.4, 11.9	FIBER CT-72 DIAMETER-.43" FIBER CT-144 DIAMETER-.63" STRAND - 6.6M GALVANIZED STRING TENSION-6600 LBS DIAMETER-.25" WT - 12.1 LBS/100'	CBX2404ATT0219
GN23440CB	NPT21		SOUTHVIEW DR	138'SW	GN23439CB	Cable	21'0"	5.4	FIBER CT- 48 DIAMETER-.4" STRAND - 6.6M GALVANIZED STRING TENSION - 6,600 LBS DIAMETER - .25" WT - 12.1 LBS/100'	CBX2404ATT0219
GN23439CB	NPT20	1625	SPILLAN RD R/W		REAR	Cable	21'0"	5.4	FIBER CT- 48 DIAMETER-.4" STRAND - 6.6M GALVANIZED STRING TENSION - 6,600 LBS DIAMETER - .25" WT - 12.1 LBS/100'	CBX2404ATT0219
GN23438CB	NPT19	1615	SPILLAN RD R/W		REAR	Cable	22'2"	5.4	FIBER CT- 48 DIAMETER-.4" STRAND - 6.6M GALVANIZED STRING TENSION - 6,600 LBS DIAMETER - .25" WT - 12.1 LBS/100'	CBX2404ATT0219
GN23415CB	NPT2		SPILLAN RD	206'N	GN23414CB	Cable	22'9"	5.4, 15.2	FIBER CT- 48 DIAMETER-.4" FIBER CT - 288 DIAMETER - .72" STRAND - 6.6M GALVANIZED STRING TENSION - 6,600 LBS DIAMETER - .25" WT - 12.1 LBS/100'	CBX2404ATT0219
GN23416CB	NPT3	1455 MEADOW LN	SPILLAN RD R/W		REAR	Cable	21'1"	15.2	FIBER CT - 288 DIAMETER - .72" STRAND - 6.6M GALVANIZED STRING TENSION - 6,600 LBS DIAMETER - .25" WT - 12.1 LBS/100'	CBX2404ATT0219
GN23417CB	NPT4	1613	MERCER CT R/W		REAR	Cable	20'6"	5.4, 15.2	FIBER CT- 48 DIAMETER-.4" FIBER CT - 288 DIAMETER - .72" STRAND - 6.6M GALVANIZED STRING TENSION - 6,600 LBS DIAMETER - .25" WT - 12.1 LBS/100'	CBX2404ATT0219
GN23418CB	NPT5	1615	MERCER CT R/W		REAR	Cable	20'7"	15.2	FIBER CT - 288 DIAMETER - .72" STRAND - 6.6M GALVANIZED STRING TENSION - 6,600 LBS DIAMETER - .25" WT - 12.1 LBS/100'	CBX2404ATT0219
GN23420CB	NPT6		MERCER CT R/W	123'E	GN23418CB	Cable	20'11"	5.4, 15.2	FIBER DROP DIAMETER-.4" FIBER CT- 288 DIAMETER - .72" STRAND - 6.6M GALVANIZED STRING TENSION - 6,600 LBS DIAMETER - .25" WT - 12.1 LBS/100'	CBX2404ATT0219
GN23422CB	NPT7		MERCER CT R/W	30'SW	GN23420CB	Cable	21'7"	15.2	FIBER CT - 288 DIAMETER - .72" STRAND - 6.6M GALVANIZED STRING TENSION - 6,600 LBS DIAMETER - .25" WT - 12.1 LBS/100'	CBX2404ATT0219
GN23424CB	NPT8	1616	MERCER CT			Cable	20'4"	15.2	FIBER CT - 288 DIAMETER - .72" STRAND - 6.6M GALVANIZED STRING TENSION - 6,600 LBS DIAMETER - .25" WT - 12.1 LBS/100'	CBX2404ATT0219
GN23426CB	NPT9	1600	MERCER CT R/W		REAR	Cable	20'8"	15.2	FIBER CT - 288 DIAMETER - .72" STRAND - 6.6M GALVANIZED STRING TENSION - 6,600 LBS DIAMETER - .25" WT - 12.1 LBS/100'	CBX2404ATT0219
GN23427CB	NPT10	301	STEWART DR			Cable	14'6"	15.2	FIBER CT - 288 DIAMETER - .72" STRAND - 6.6M GALVANIZED STRING TENSION - 6,600 LBS DIAMETER - .25" WT - 12.1 LBS/100'	CBX2404ATT0219
GN23428CB	NPT11		SOUTHVIEW DR	164'SW	GN23427CB	Cable	22'11"	5.4, 15.2	FIBER DROP DIAMETER-.4" FIBER CT - 288 DIAMETER - .72" STRAND - 6.6M GALVANIZED STRING TENSION - 6,600 LBS DIAMETER - .25" WT - 12.1 LBS/100'	CBX2404ATT0219
GN23430CB	NPT12	1745	SOUTHVIEW DR			Cable	22'1"	5.4, 5.4, 15.2	FIBER DROP DIAMETER-.4" FIBER DROP DIAMETER-.4" FIBER CT - 288 DIAMETER - .72" STRAND - 6.6M GALVANIZED STRING TENSION - 6,600 LBS DIAMETER - .25" WT - 12.1 LBS/100'	CBX2404ATT0219

GN23432CB	NPT13	195	EDGEFIELD DR R/W		REAR	Cable	19'10"	5.4	FIBER CT- 48 DIAMETER-.4" STRAND - 6.6M GALVANIZED STRING TENSION - 6,600 LBS DIAMETER - .25" WT - 12.1 LBS/100'	CBX2404ATT0219
GN23433CB	NPT14	165	EDGEFIELD DR R/W		REAR	Cable	18'7"	5.4	FIBER CT- 48 DIAMETER-.4" STRAND - 6.6M GALVANIZED STRING TENSION - 6,600 LBS DIAMETER - .25" WT - 12.1 LBS/100'	CBX2404ATT0219
GN23434CB	NPT15	145	EDGEFIELD DR R/W		REAR	Cable	18'7"	5.4	FIBER CT- 48 DIAMETER-.4" STRAND - 6.6M GALVANIZED STRING TENSION - 6,600 LBS DIAMETER - .25" WT - 12.1 LBS/100'	CBX2404ATT0219
GN23435CB	NPT16	135	EDGEFIELD DR R/W		REAR	Cable	18'7"	5.4	FIBER CT- 48 DIAMETER-.4" STRAND - 6.6M GALVANIZED STRING TENSION - 6,600 LBS DIAMETER - .25" WT - 12.1 LBS/100'	CBX2404ATT0219
GN23436CB	NPT17	115	EDGEFIELD DR R/W		REAR	Cable	17'2"	5.4	FIBER CT- 48 DIAMETER-.4" STRAND - 6.6M GALVANIZED STRING TENSION - 6,600 LBS DIAMETER - .25" WT - 12.1 LBS/100'	CBX2404ATT0219
GN23437CB	NPT18		SPILLAN RD R/W	51'SW	GN23417CB	Cable	20'7"	5.4	FIBER CT- 48 DIAMETER-.4" STRAND - 6.6M GALVANIZED STRING TENSION - 6,600 LBS DIAMETER - .25" WT - 12.1 LBS/100'	CBX2404ATT0219
GN23461CB	NPT39	1630	SPILLAN RD R/W			Cable	20'9"	5.4	FIBER CT-72 DIAMETER-.43" STRAND-6.6M GALVANIZED STRING TENSION-6,600 LBS DIAMETER-.25" WT-12.1 LBS/100'	CBX2404ATT0219
GN23463CB	NPT40	1635	RANDALL RD R/W		REAR	Cable	20'8"	5.4, 5.4	FIBER DROP DIAMETER-.4" FIBER CT-72 DIAMETER-.43" STRAND-6.6M GALVANIZED STRING TENSION-6,600 LBS DIAMETER-.25" WT-12.1 LBS/100'	CBX2404ATT0219
GN23465CB	NPT1		RANDALL RD	188'W	GN23463CB	Cable		5.4	FIBER CT-72 DIAMETER-.43" STRAND-6.6M GALVANIZED STRING TENSION-6,600 LBS DIAMETER-.25" WT-12.1 LBS/100'	CBX2404ATT0232
GN23466CB	NPT2	130	EDGEFIELD DR R/W		REAR	Cable		5.4	FIBER CT-72 DIAMETER-.43" STRAND-6.6M GALVANIZED STRING TENSION-6,600 LBS DIAMETER-.25" WT-12.1 LBS/100'	CBX2404ATT0232
GN23467CB	NPT3	110	EDGEFIELD DR R/W		REAR	Cable		5.4	FIBER CT-72 DIAMETER-.43" STRAND-6.6M GALVANIZED STRING TENSION-6,600 LBS DIAMETER-.25" WT-12.1 LBS/100'	CBX2404ATT0232
GN23468CB	NPT4	1640	SPILLAN RD R/W		REAR	Service		5.4	FIBER DROP DIAMETER-.4"	CBX2404ATT0232
GN23469CB	NPT5	1700	SPILLAN RD R/W		REAR	Service		5.4	FIBER DROP DIAMETER-.4"	CBX2404ATT0232
GN23470CB	NPT6		SPILLAN RD	124'S	GN23453CB	Cable		5.4	FIBER CT-24 DIAMETER-.4" STRAND-6.6M GALVANIZED STRING TENSION-6600 LBS DIAMETER-.25" WT-12.1 LBS/100'	CBX2404ATT0232
GN23472CB	NPT7	1775	SOUTHVIEW DR R/W		REAR	Cable		5.4	FIBER CT-24 DIAMETER-.4" STRAND-6.6M GALVANIZED STRING TENSION-6600 LBS DIAMETER-.25" WT-12.1 LBS/100'	CBX2404ATT0232
GN23473CB	NPT8	1771	SOUTHVIEW DR R/W		REAR	Cable		5.4	FIBER CT-24 DIAMETER-.4" STRAND-6.6M GALVANIZED STRING TENSION-6600 LBS DIAMETER-.25" WT-12.1 LBS/100'	CBX2404ATT0232
GN23474CB	NPT9	1763	SOUTHVIEW DR R/W		REAR	Cable		5.4	FIBER CT-24 DIAMETER-.4" STRAND-6.6M GALVANIZED STRING TENSION-6600 LBS DIAMETER-.25" WT-12.1 LBS/100'	CBX2404ATT0232
GN23475CB	NPT10		SPILLAN RD	108'S	GN23470CB	Cable		0	'STRAND ONLY' STRAND - 6.6M GALVANIZED STRING TENSION - 6,600 LBS DIAMETER - .25" WT - 12.1 LBS/100'	CBX2404ATT0232
GN23476CB	NPT11		RANDALL RD R/W	65'W	GN23477CB	Service		5.4	FIBER DROP DIAMETER-.4"	CBX2404ATT0232
GN23477CB	NPT12	1650	RANDALL RD R/W		REAR	Service		5.4	FIBER DROP DIAMETER-.4"	CBX2404ATT0232