


VILLAGE OF YELLOW SPRINGS
STANDARD INSTALLATION FOR RESIDENTIAL (5/8 x 3/4" METER)
WATER SERVICE CONNECTION

SUPPLIED BY THE VILLAGE

1. 5/8 x 3/4 WATER METER
2. FORD NO. Y502 YOKE BAR
FORD AV92-324W OR AV94-324W
INLET AND OUTLET VALVE
FORD EC-23 EXPANSION CONNECTION
3. FORD BALL VALVE CURB STOP B44-343
OR APPROVED EQUAL

SUPPLIED BY CUSTOMER

4. PLASTIC METER BOX 20" DIAMETER
OR APPROVED EQUAL
5. FORD NO. W3 "FROST LID" METER
PIT COVER OR EQUAL (WITH HOLE
IN TOP & PLASTIC CAP)
6. WATER SERVICE LINES 3/4" COPPER
7. COPPER ON AT LEAST ONE SIDE TO
STABILIZE YOKE

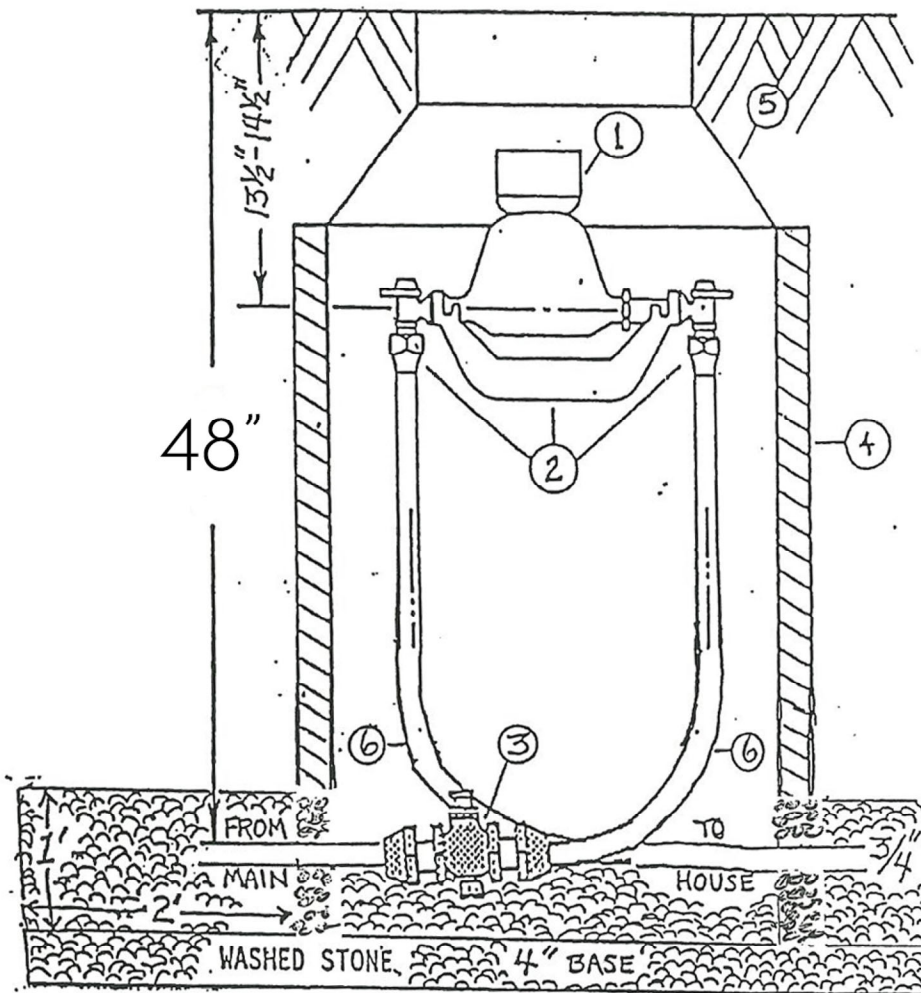

ALL METER PITS MUST BE AT LEAST ONE (1) FOOT, BUT NO MORE THAN
SIX (6) FEET INSIDE PROPERTY LINE/SIDEWALK